DOCUMENT RESUME

ED 062 692 EA 004 195

AUTHOR Walsh, David P.
TITLE Rating System for Evaluating the Acoustical Environment of Existing School Facilities.
PUB DATE 22 Oct 71
NOTE 19p.; Paper presented at Acoustical Society of America Annual Meeting (82nd, Denver, Colorado, October 22, 1971)

EDRS PRICE MF-$0.65 HC-$3.29
DESCRIPTORS *Acoustical Environment; Acoustic Insulation; Building Obsolescence; Cost Effectiveness; Educational Facilities; Evaluation Methods; Facility Guidelines; *Facility Inventory; Facility Requirements; *Rating Scales; School Environment; *School Improvement; Speeches; *Standards
IDENTIFIERS CFI; Computerized Facilities Inventory; San Francisco Unified School District

ABSTRACT

A major survey of all schools built prior to 1933 was conducted after the enactment of the Field Act, which, in California, required specific school construction standards for earthquake safety. One aspect of this study, the acoustical environment of San Francisco Schools, is described in this speech. The document outlines the following procedures: (1) for the acoustical portion of the survey, a field survey was made to establish the existing condition at the facilities; (2) deficit documentation, which involved matching the existing conditions against the district standards by computer, was then completed; (3) unit costs for corrective work on all substandard areas were developed; and (4) cost benefit tables that matched the deficit documentation with the unit costs for corrective action were established. Portions of the forms used and computer printouts are included. (Figures 1 and 6 will reproduce poorly because of marginal legibility.) (Author/MLF)

FILMED FROM BEST AVAILABLE COPY

"PERMISSION TO REPRODUCE THIS COPYRIGHTED MATERIAL HAS BEEN GRANTED BY
M.P. Berline, for
CFI Survey Form, Fig. 7
TO ERIC AND ORGANIZATIONS OPERATING UNDER AGREEMENTS WITH THE U.S. OFFICE OF EDUCATION. FURTHER REPRODUCTION OUTSIDE THE ERIC SYSTEM REQUIRES PERMISSION OF THE COPYRIGHT OWNER."

U.S. DEPARTMENT OF HEALTH, EDUCATION & WELFARE
OFFICE OF EDUCATION
THIS DOCUMENT HAS BEEN REPRODUCED EXACTLY AS RECEIVED FROM THE PERSON OR ORGANIZATION ORIGINATING IT. POINTS OF VIEW OR OPINIONS STATED DO NOT NECESSARILY REPRESENT OFFICIAL OFFICE OF EDUCATION POSITION OR POLICY.

ED 062 692

RATING SYSTEM FOR EVALUATING THE ACOUSTICAL ENVIRONMENT OF EXISTING SCHOOL FACILITIES

by

David P. Walsh

Wilson, Ihrig & Associates, Inc.
~~2344 Sixth Street~~
~~Berkeley, California 94710~~
5605 OCEAN VIEW DRIVE
OAKLAND, CALIFORNIA 94618

Presented at the 82nd Meeting of the Acoustical Society of America;
Session HH, Room Acoustics; Denver, Colorado; 22 October 1971

EA 004 195

If we were to take a sampling of the recent literature dealing with educational facilities we would see such topics discussed as innovative architectural planning concepts, new school construction techniques and system components, new concepts of space planning, student orientation, etc. However, a much more serious problem faces school administrators in major cities who must contend with the constant upkeep of existing, often sub-standard, school facilities.

If we look at the situation from an historical standpoint, we can see how the problem has developed over the years. During the Depression years most urban school construction stopped and little construction occurred during the following war years. During the late 40's, 50's, and 60's the southern Black immigration into the cities was matched by the FHA-sponsored white emigration out of the cities, into the suburbs. The result was a negligible net change in the public school population.

Since, typically, new schools are built to meet increased enrollment most urban schools in major U.S. cities date back to just after the turn of the century. Due to this situation the school market is now expanding to meet the renovation needs of these antiquated inner-city buildings. This is occurring because renovation is more expedient than new construction, and because it is less expensive.

In most instances, however, school districts have not developed an effective, systematic approach to school renovation or plant repair and have no way of determining the extent of renovation required throughout the district. One approach towards organizing the numerous factors inherent in the physical upkeep of school facilities was developed for the San Francisco Unified School District [SFUSD]. This program, called the Computerized Facilities Inventory [CFI], was developed by Architect M. P. Berline* of San Francisco under a grant from the Educational Facilities Laboratory, Incorporated.

This program included a major survey of all schools built prior to 1933 when the Field Act, which in California required specific school construction standards for earthquake safety, was enacted.

Figure 1 shows the location of the schools surveyed in San Francisco. The total number of schools involved in the survey was 61 [49 elementary, 8 junior high, and 4 senior high schools], represneting a combined enrollment of approximately 50,000 students, or about half of the total enrollment of the School District.

As part of this study each teaching space was surveyed and data on its physical condition was collected in each of the following categories: Ventilation and Heating Systems, Lighting, Architectural, and Acoustics.

---

* Michel Paul Berline, Architect
School Renovation System, Inc.
60 Union Street
San Francisco, California 94111

In each of these categories the same approach for defining the problem was followed, as shown on Figure 2: STANDARDS were established, based on standard units of measure available in each area of concern; a STATEMENT OF THE EXISTING CONDITION OF THE FACILITIES was made [i.e., a field survey]; DEFICIT DOCUMENTATION was then completed which involved matching the existing conditions against the District standards by computer; DEVELOPMENT OF UNIT COSTS for corrective work on all sub-standard areas; and ESTABLISHMENT OF COST/BENEFIT TABLES which matched the deficit documentation with the unit costs for corrective action.

The STANDARDS used for the acoustical portion of the survey were developed from the three basic parameters of Architectural Acoustics: NOISE CONTROL, SOUND ISOLATION, and ROOM ACOUSTICS; and the standard units of measure that relate to them, such as; NC levels, Noise Reduction [NR] of various building constructions, Reverberation Time [RT] within spaces, etc.

However, the time and instrumentation associated with collecting this type of data for each teaching space would have been prohibitively expensive. For example, it would have cost in the range of $200 to $300 per classroom to obtain this data or about $11,000 for a typical elementary school.

More importantly, however, the degree of accuracy obtained in these types of objective measurements was not required and, in fact, could not have been used. The degree of accuracy which was required in this Survey was that which could specify corrective action for typical acoustical deficiencies. Therefore, as seen on Figure 3, the approach that was taken was to establish approximations of the standard acoustical units of measure which could then be used to subjectively evaluate the existing conditions in the field.

As a first step in developing the FIELD APPROXIMATIONS of acceptable levels for both background and intruding noises, the types of teaching spaces used in the School District were tabulated. Since there are a large number of different types of teaching spaces in the district their acceptable noise levels are related to the type of activity in each space. Figure 4 is a SPACE IDENTIFICATION TYPE chart which shows the types of teaching spaces in the School District and their acceptable background noise levels.

The next step was to prepare a Survey Form which we could take to the various schools and record data on sub-standard acoustical areas. This required taking the FIELD APPROXIMATIONS of our standard acoustical units of measure to identify the typical noise sources encountered in schools and relating them to the normal sound transmission paths found in school construction. An example of this is shown on Figure 5 for the major noise source in schools - playgrounds. We then combined these parameters with the SPACE IDENTIFICATION TYPES to allow for every possible combination of noise source, sound transmission path, and teaching space. This combination of parameters resulted in a Survey Form which is shown on Figure 6.

This chart is obviously much too cumbersome and confusing to use in the field survey. Therefore, a much simpler chart had to be developed. This was accomplished in the following manner. For both the NOISE CONTROL and SOUND ISOLATION sections the ambient noise level and the level of intruding noise within the space were to be subjectively rated on a scale from 1 to 4, relative to the type of activity within the space:

1. NOISE LEVEL IS UNOBTRUSIVE FOR ALL FUNCTIONS

   This represents the range of Sound Pressure Levels [SPL] normally found in Music Rooms, Practice Rooms, etc.

2. NOISE LEVEL IS UNOBTRUSIVE FOR TEACHING FUNCTIONS

   This represents the range of SPL's within a space which allows a high degree of speech intelligibility at normal conversational voice levels.

3. NOISE LEVEL IS HAMPERING TO TEACHING FUNCTIONS

   This represents the range of SPL's within a space which makes it necessary to use a raised voice level in order to communicate intelligibily.

4. NOISE LEVEL IS DISRUPTIVE TO TEACHING FUNCTIONS

   This represents the range of SPL's within a space which makes it necessary to use a raised voice level at very close distances in order to communicate intelligibly.

Since the primary purpose of this survey was to determine areas where corrective action was required, teaching spaces that had subjectively QUIET or UNOBTRUSIVE noise levels were not recorded.

For the ROOM ACOUSTICS section the acoustical environment due to finish materials and space geometry was to be noted. The Reverberation Time within the space was to be rated in one of four ways:

THIS SPACE HAS A LOW REVERBERATION TIME SUITABLE FOR DRAMA, MUSIC PRACTICE, ETC.

THIS SPACE HAS AN ACCEPTABLE REVERBERATION TIME FOR TEACHING.

THIS SPACE PRODUCES AN ANNOYING DISTORTION OF SPEECH SOUNDS.

THIS SPACE IS TOO REVERBERANT FOR INTELLIGIBLE SPEECH.

Other acoustical phenomena within the space, such as FLUTTER, ECHO, and FOCUSING OF SOUND, and recommendations for the placement of sound absorptive materials to correct these shortcomings were also to be noted on the chart.

These field approximations resulted in the development of the chart shown on Figure 7,* which was used throughout the survey.

As an example of the survey procedure the acoustical deficiencies of a typical classroom are shown here:

- The top number indicates the computer designation of the school and the floor level.
- The room number is listed below. [Space is provided for additional room numbers since the ratings for several classrooms in a school may be identical.]

---

* Note: The charts developed for the CFI Survey are copyrighted.

- Acoustical deficiencies of the 3 and 4 categories are indicated in the SOUND ISOLATION section. [Apparently this classroom is adjacent to a playground and the operable sash windows are inadequate to reduce the playground noise to an unobtrusive level. Similarly, the door to the corridor is acoustically inadequate.]

- Lastly, the ROOM ACOUSTICS rating and recommendation are shown.

The results of the Acoustical Survey, plus the results of all the other surveys, were recorded on punch cards for each teaching space and stored in the School District's accounting computers at the Board of Education Building.

Concurrent with the completion of the Survey, a list of UNIT PRICES FOR CORRECTIVE ACTION was developed in which the costs for all work necessary to correct the acoustical deficiencies recorded in the Survey were established. This cost information was also stored in the computers and is updated periodically to reflect labor and material cost changes.

Once the Survey was completed, coded, and fed into the computer, the cost of any or all corrective work was available to the appropriate personnel on the Board of Education. An example of the COST/BENEFIT information available from the computer for the acoustical corrective work in a particular school is shown on Figure 8.

From the Survey it was found that the primary acoustical deficiency common to the majority of spaces was the lack of acoustical isolation provided by the windows. This inadequate isolation is due to several factors. The windows are the old type of wood frame, operable sash windows which have warped considerably over the past 40 years. Gaps between the sash and the sill can be

as much as 1/4" when the windows are completely closed and locked. Another important factor is that the type and patterns of vehicular traffic have changed significantly since these schools were built with a resulting increase in vehicular noise levels. Lastly, and most importantly, the school curriculum at the turn of the century when these schools were designed called for a common recess time for the entire school. Today classes rotate their recess times with the result that several classes use the playground continuously throughout the school day creating a day-long, high-level noise source.

In these schools the only available action for reducing the levels of disruptive exterior noise is to close the windows. Therefore our most important recommendation for remedial work was to improve the noise reduction provided by the windows. There were two degrees for this corrective work. The first was to eliminate the leakage paths and to provide airtight seals at the jamb and sill by means of resilient gasketing. The second, where higher exterior noise levels existed, such as from a playground, entailed permanently sealing the existing windows and applying a sheet of 1/4" Plexiglas to the exterior wood frame. Figure 9 shows the detail used for this corrective work.

We were fortunate to have the opportunity of evaluating the improvement in noise reduction provided by this construction in one of the schools used in the Survey. This slide [Figure 10] is a photograph of the exterior of a typical classroom adjacent to a playground. The next slide [Figure 11] shows a close-up of one of the windows. Next is a slide [Figure 12] showing the double glazing construction in place. The cost of this installation was approximately $2.00 to $2.50 per square foot including labor and materials.

The major drawback to this type of detail is that the only source of fresh air for the classroom is sealed off. To compensate for this some form of forced air ventilation is required. As an outgrowth of the data collected in the Computerized Facilities Inventory, Architect Berline and his firm developed a modular, systems unit for school renovation which has the capability of providing such functions as forced air ventilation wherever necessary. An example of this approach is shown in the next two slides. The first slide [Figure 13] shows the interior of a typical classroom which has the standard, turn of the century finish treatments of linoleum flooring, plaster walls and ceilings, incandescent lighting, and the same wood frame, operable sash windows which were seen earlier. The next slide [Figure 14] shows the same classroom with the prototype of the School Renovation System installed, together with a new carpet and a fresh coat of paint. The system consists of an integral, "plug-in" suspension unit which contains: completely ducted unit ventilators, air supply and return diffusers, fluorescent fixtures, electrical power supply, lay-in acoustical ceiling panels, etc. To install one of these units in a classroom takes five working days and costs between $5.00 and $7.00 per square foot, plus service runs to the unit.

In summary, the major problem facing urban School Districts is that of improving the physical condition of their all-too-often antiquated school facilities. The most expedient way of upgrading these physical conditions is through school renovation rather than through new school construction, because it is faster and more economical.

As was discovered in the Computerized Facilities Inventory the one, significant problem existing in urban schools requiring corrective action is acoustics; that is, Noise Control, Sound Isolation, and Room Acoustics. From the data obtained in the Survey for the San Francisco Unified School District the computer cost analysis for corrective work shows that Acoustics Related problems alone run from 40% to 50% of the <u>total</u> cost figure.

The problem of upgrading existing school facilities is a very real and serious one, one which will not disappear by itself. A practical, systematic approach which will adequately define the problems of school renovation, provide realistic solutions, and present them in a usable format for school administrators is required. The procedures and techniques described here for the San Francisco Survey have, we feel, accomplished these goals.

FIGURE 1: LOCATION OF SCHOOLS SURVEYED IN THE SAN FRANCISCO UNIFIED SCHOOL DISTRICT FOR THE COMPUTERIZED FACILITIES INVENTORY

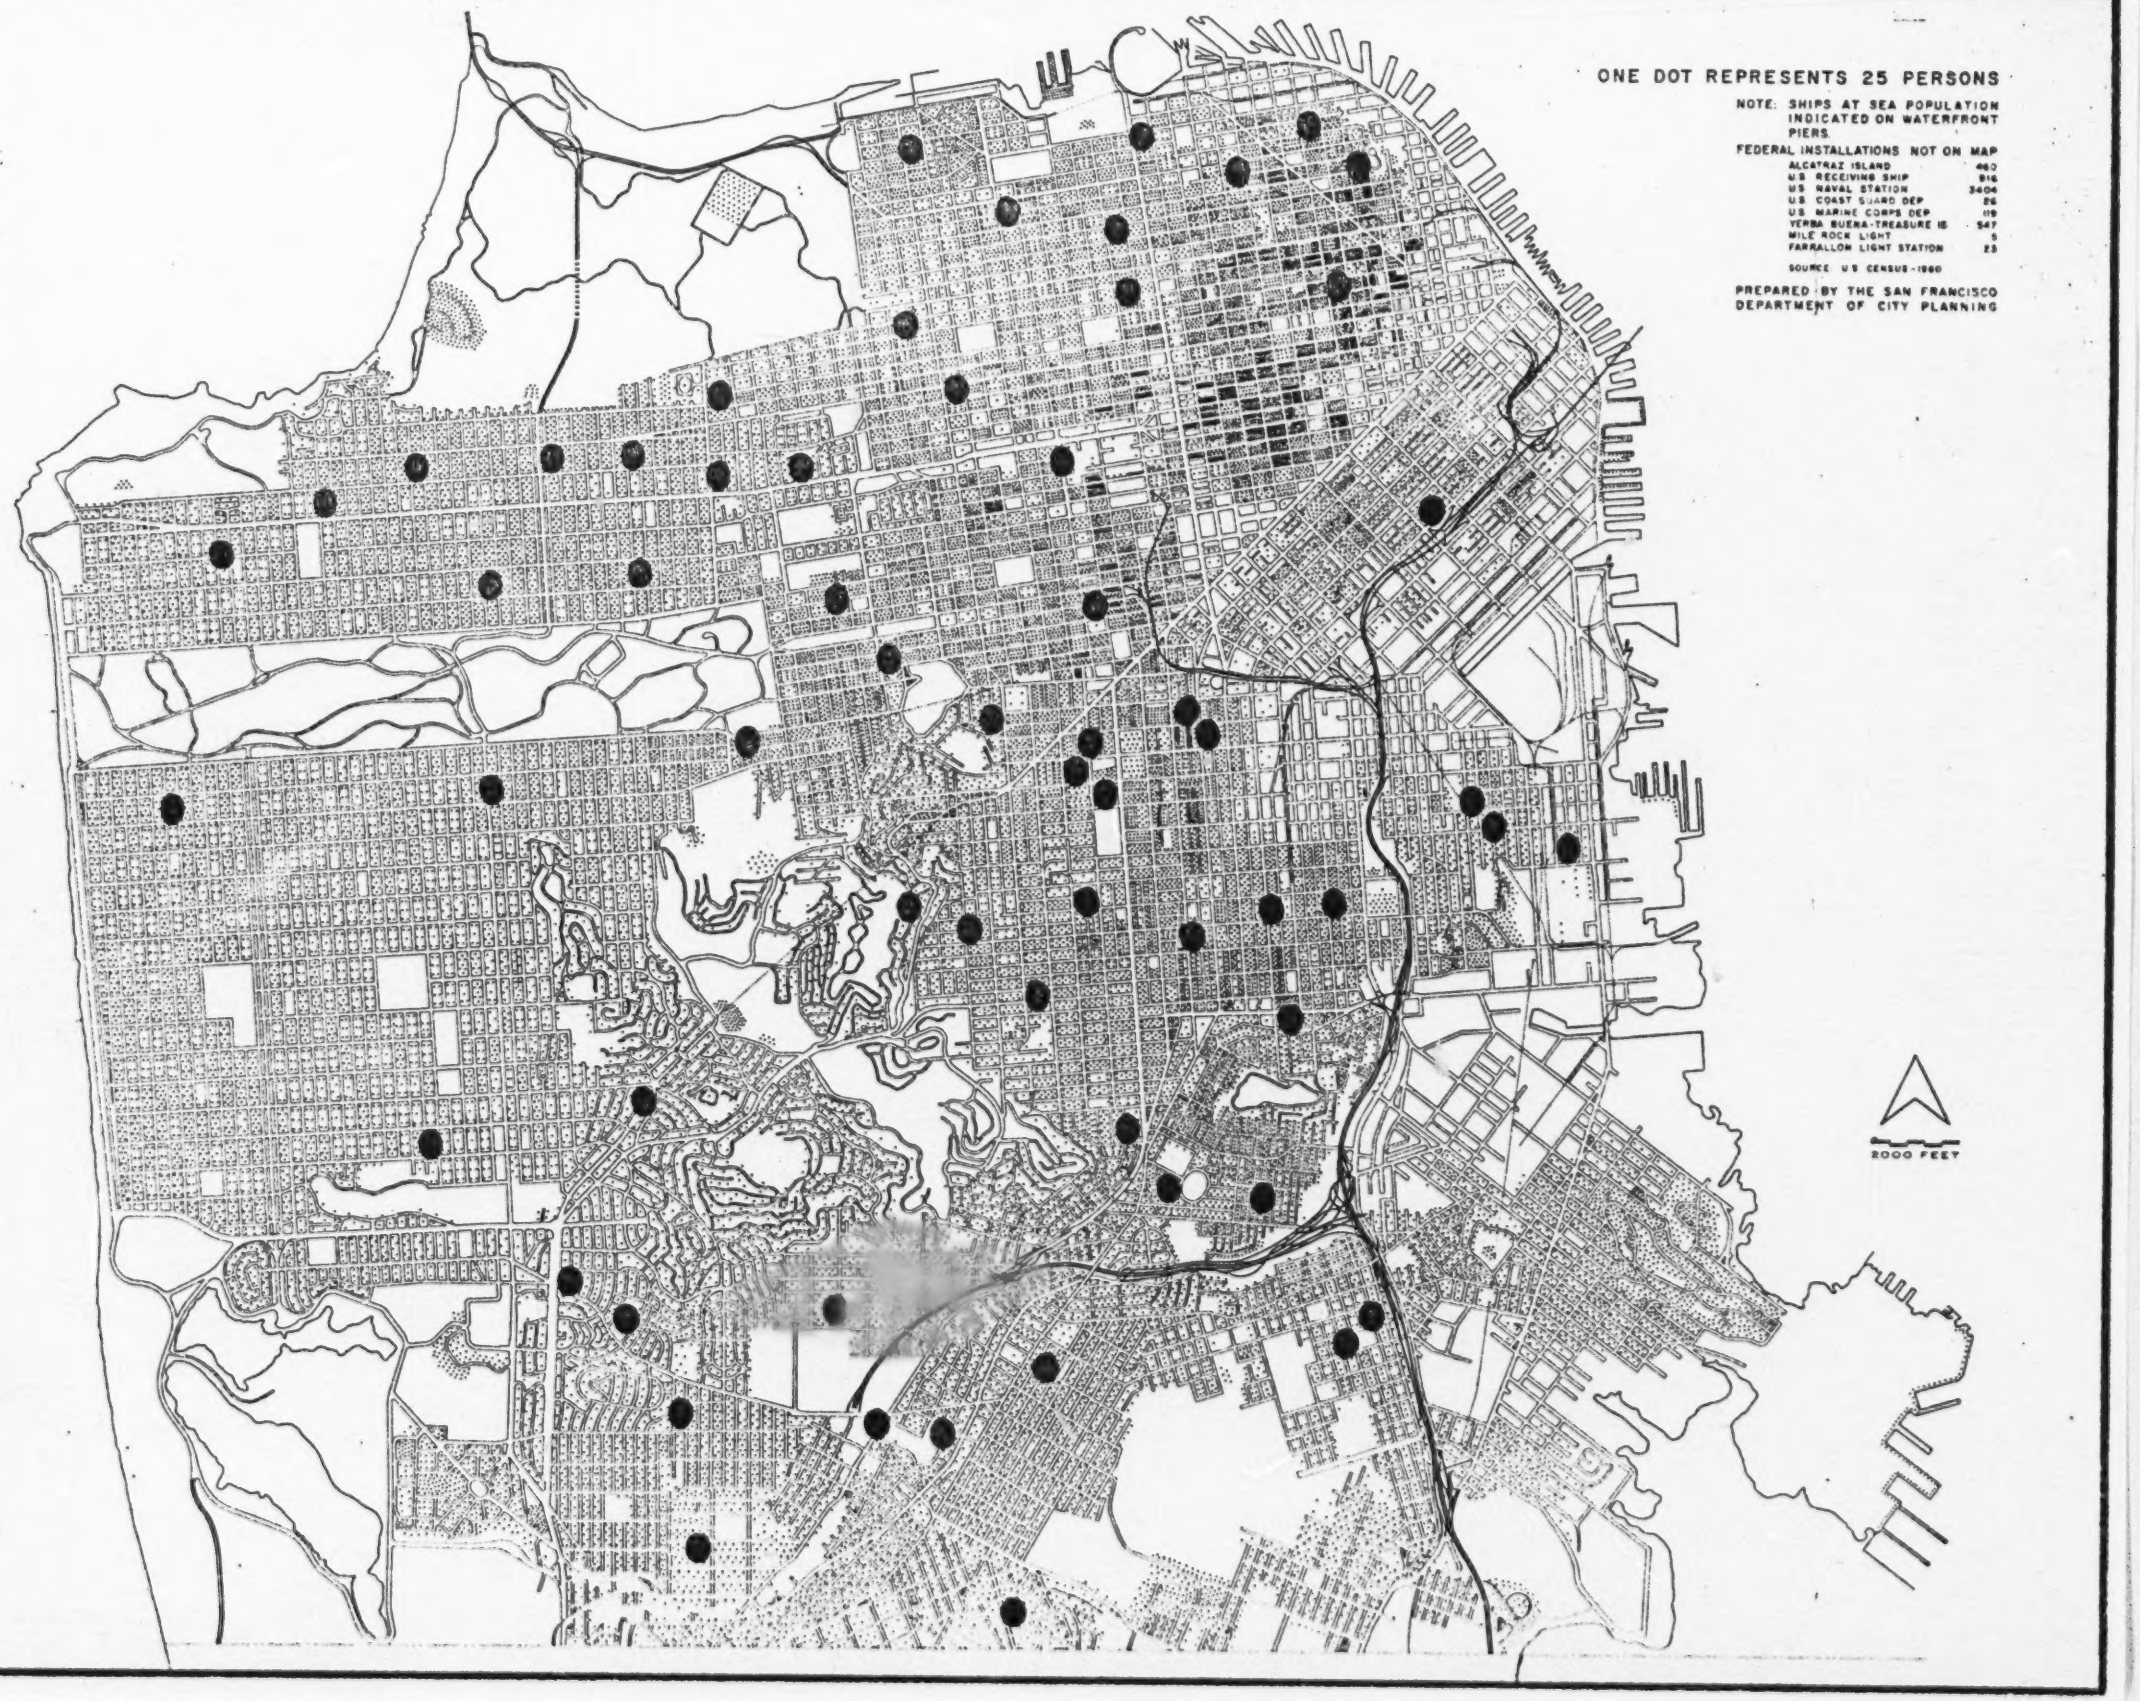
ONE DOT REPRESENTS 25 PERSONS
NOTE: SHIPS AT SEA POPULATION INDICATED ON WATERFRONT PIERS.
FEDERAL INSTALLATIONS NOT ON MAP
ALCATRAZ ISLAND 460
U.S. RECEIVING SHIP 916
U.S. NAVAL STATION 3404
U.S. COAST GUARD DEP 26
U.S. MARINE CORPS DEP 119
YERBA BUENA-TREASURE IS 547
MILE ROCK LIGHT 5
FARRALLON LIGHT STATION 23
SOURCE U.S. CENSUS-1960
PREPARED BY THE SAN FRANCISCO DEPARTMENT OF CITY PLANNING
2000 FEET

ESTABLISHMENT OF STANDARDS

STATEMENT OF THE EXISTING CONDITION OF THE FACILITIES

DEFICIT DOCUMENTATION

DEVELOPMENT OF UNIT COSTS

ESTABLISHMENT OF COST/BENEFIT TABLES

FIGURE 2: PROCEDURE FOR COMPUTERIZED FACILITIES INVENTORY

STANDARD ACOUSTICAL UNITS	FIELD APPROXIMATIONS
1. <u>NOISE CONTROL</u> SPL NC dBA PSIL	1. IDENTIFY NOISE SOURCES WITHIN SPACES
2. <u>SOUND ISOLATION</u> NR TL INR	2. IDENTIFY NOISE SOURCES OUTSIDE THE SPACE AND DETERMINE HOW THEY ARE TRANSMITTED TO THE SPACE (A) Airborne (B) Structure-borne
3. <u>ROOM ACOUSTICS</u> RT AI	3. EVALUATE THE QUALITY OF SOUND WITHIN THE SPACE AND DETERMINE THE CAUSITIVE FACTOR (A) Room Finish Treatment (B) Room Geometry

FIGURE 3: RELATIONSHIP BETWEEN STANDARD ACOUSTICAL UNITS OF MEASURE AND FIELD APPROXIMATIONS USED IN CFI SURVEY

FIGURE 4: SPACE IDENTIFICATION TYPES FOR SFUSD

A.	Standard Classroom Spaces	Academic Classrooms Reading Rooms Individual Study Areas	NC 35-40
B.	Specialized Classroom Spaces	1. General Science Classrooms Language Classrooms	NC 35-40
		2. Business Machines Typing Classrooms	NC 40-45
C.	Large Group Instruction Spaces	1. Band Rooms Orchestra Rooms Choral Rooms Auditoriums Theatres	NC 25-30
		2. Multipurpose II Spaces	NC 35-40
D.	Small Group Instruction Spaces	1. Seminar Rooms	NC 35-40
		2. Music Practice Rooms	NC 25-30
E.	Academic Laboratories	Drafting Rooms Biology Labs Chemistry Labs Mathematics Labs Physics Labs	NC 35-40
F.	Craft Laboratories	1. Arts and Crafts Dramatic Arts Homemaking	NC 35-40
		2. Auto Shop Electrical Shop Wood Shop Metal Shop Print Shop	NC 40-45
G.	Activity Spaces	Gymnasiums Cafeterias Multipurpose I Spaces (Self Contained)	NC 40-45
H.	Administrative Spaces	Offices Counseling Areas Library Catalog Control Faculty Work Rooms Faculty Lounge	NC 35-40

FIGURE 5: PORTION OF COMPUTER INPUT FOR EVALUATING PLAYGROUND NOISE

```
080  10  20  20  100   NOISE FROM PLAYGROUNDS IS BELOW AMBIENT
080  10  20  20  400   NOISE FROM PLAYGROUNDS IS UNOBTRUSIVE FOR CLASSROOM FUNCTIONS
080  10  20  20  600   NOISE FROM PLAYGROUNDS IS UNOBTRUSIVE FOR SHOP FUNCTIONS
080  10  20  20  900   NOISE FROM PLAYGROUNDS IS DISRUPTIVE TO TEACHING FUNCTIONS
080  10  20  20  910   SOUND TRANSMISSION IS THRU GLASS
080  10  20  20  920   SOUND TRANSMISSION IS THRU OPERABLE SASH
080  10  20  20  930   SOUND TRANSMISSION IS THRU MECHANICAL SYSTEM
080  10  20  20  932   SOUND TRANSMISSION IS THRU MECH. VENT TO OUTSIDE
080  10  20  20  933   SOUND TRANSMISSION IS THRU GRAVITY VENT TO OUTSIDE
080  10  20  20  934   SOUND TRANSMISSION IS THRU MECH. VENT TO ADJACENT SPACE
080  10  20  20  935   SOUND TRANSMISSION IS THRU GRAVITY VENT TO ADJACENT SPACE
080  10  20  20  936   SOUND TRANSMISSION IS THRU GRAVITY SUPPLY FROM OUTSIDE
080  10  20  20  937   SOUND TRANSMISSION IS THRU MECHANICAL SUPPLY FROM OUTSIDE
080  10  20  20  938   SOUND TRANSMISSION IS THRU  GRAVITY  SUPPLY FROM ADJACENT SPACE
080  10  20  20  939   SOUND TRANSMISSION IS THRU MECHANICAL SUPPLY FROM ADJACENT SPACE
080  10  20  20  940   SOUND TRANSMISSION IS THRU CEILING
080  10  20  20  950   SOUND TRANSMISSION IS THRU FLOOR
080  10  20  20  960   SOUND TRANSMISSION IS THRU WALLS TO ADJACENT SPACE
080  10  20  20  970   SOUND TRANSMISSION IS THRU TO CORRIDOR
080  10  20  20  972   SOUND TRANSMISSION IS THRU DOOR TO CORRIDOOR
080  10  20  20  975   SOUND TRANSMISSION IS THRU WALL TO CORRIDOR
080  10  20  20  978   SOUND TRANSMISSION IS THRU GLAZING TO CORRIDOR
080  10  20  20  980   SOUND TRANSMISSION IS THRU OPENINGS TO ADJACENT SPACE
```

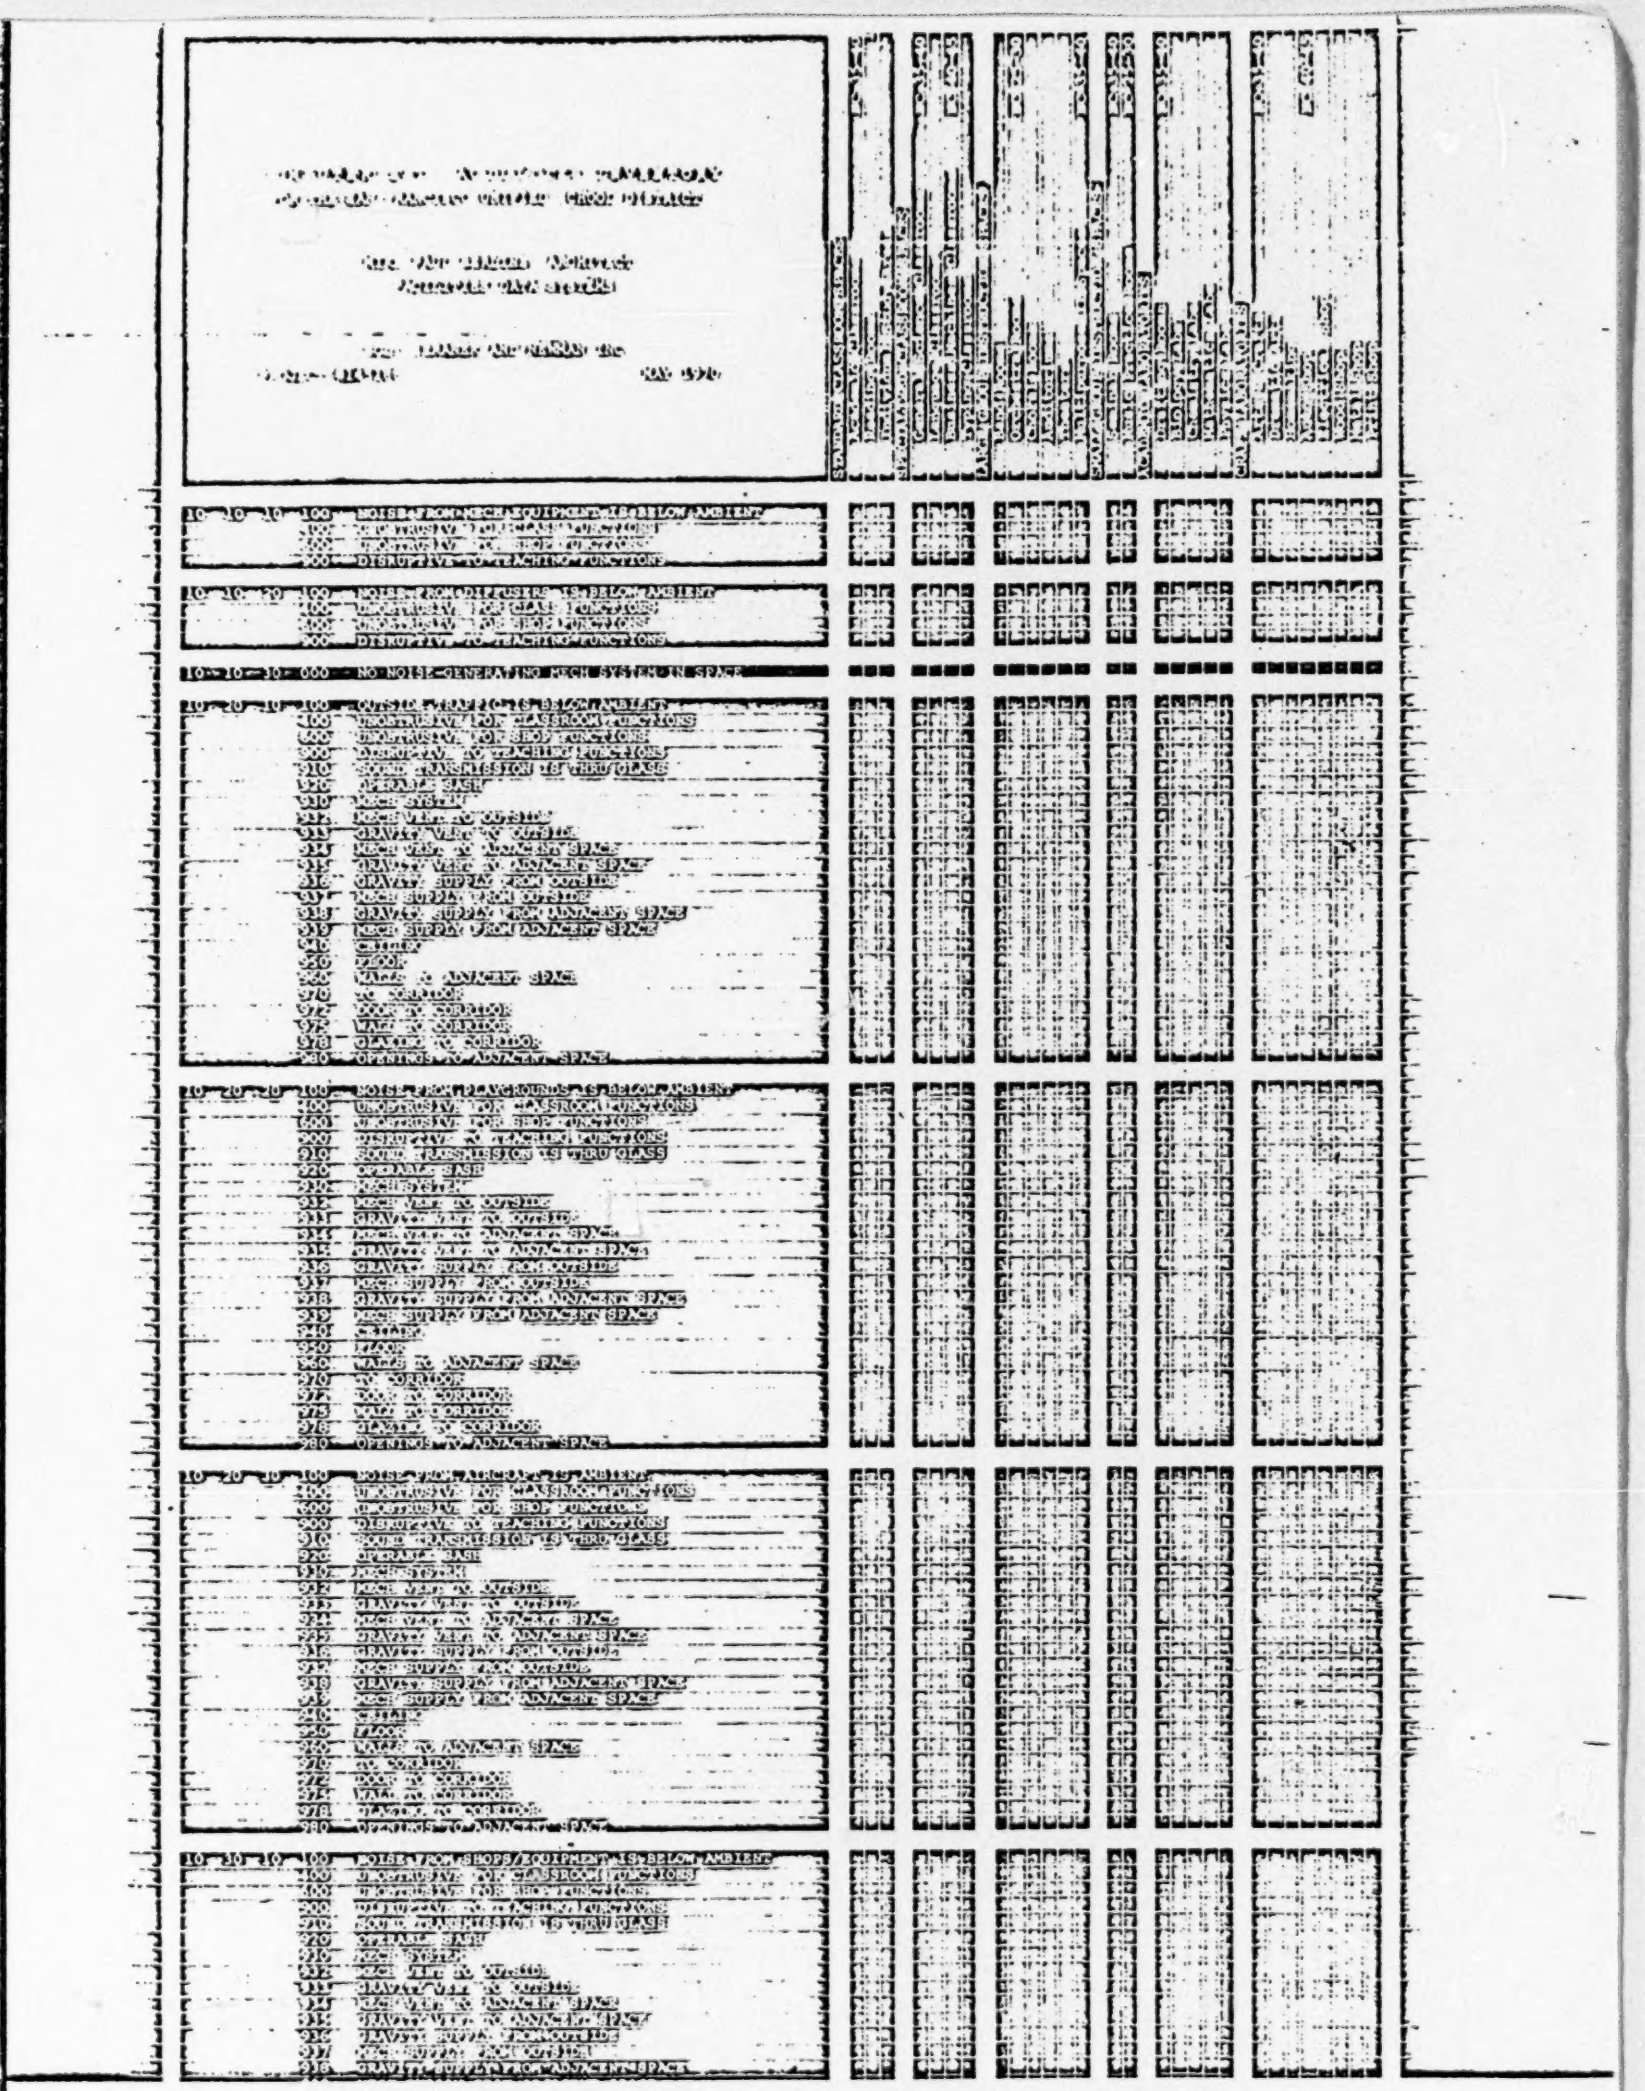

FIGURE 6: PORTION OF PRELIMINARY ACOUSTICAL SURVEY FORM

[Note]: This Form continues for 6 more sections

FIGURE 7: CFI SURVEY FORM

SCHOOL SHERMAN ELEMENTARY NUMBER 0 2 3 3 8 2 2 0 FLOOR

INSPECTOR DPW DATE 8 Sept 70

ROOM NUMBERS 204

NOISE LEVEL IN SPACE IS VERY QUIET 080 000 100 001 ☐ NOISE LEVEL IN SPACE IS OK FOR TEACHING 080 000 100 002 ☐

ENTER '3' IF NOISE LEVEL IS HAMPERING FOR TEACHING FUNCTION
ENTER '4' IF NOISE LEVEL IS DISRUPTIVE TO TEACHING FUNCTION

| | | |

FIGURE 8: PORTION OF COMPUTER PRINTOUT OF COSTS FOR ACOUSTICAL CORRECTIVE ACTION

SPACE ID	TYPE OF CORRECTIVE ACTION REQUIRED	COST FOR CORRECTIVE ACTION SPECIFIED
02339610080	ABSORB SOUND AT CEILING	$ 144.00
02339610113	ABSORB SOUND AT CEILING	$ 286.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 2,288.00
02339610113A	ABSORB SOUND AT CEILING	$ 97.50
	BLOCK SOUND THROUGH DOORS	$ 200.00
02339610190	ABSORB SOUND AT CEILING	$ 192.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 1,536.00
02339628006	ABSORB SOUND AT CEILING	$ 372.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 2,976.00
	BLOCK SOUND THROUGH DOORS	$ 100.00
02339628007	ABSORB SOUND AT CEILING	$ 384.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,072.00
	BLOCK SOUND THROUGH DOORS	$ 100.00
02339628008	ABSORB SOUND AT CEILING	$ 384.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,072.00
	BLOCK SOUND THROUGH DOORS	$ 200.00
02339628009	ABSORB SOUND AT CEILING	$ 384.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,072.00
	BLOCK SOUND THROUGH DOORS	$ 100.00
02339628294	ABSORB SOUND AT CEILING	$ 408.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,264.00
02339620015	ABSORB SOUND AT CEILING	$ 416.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,328.00
02339620016	ABSORB SOUND AT CEILING	$ 416.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,328.00
02339620017	ABSORB SOUND AT CEILING	$ 416.00
	BLOCK SOUND THROUGH OPERABLE SASH	$ 3,328.00
	BLOCK SOUND THROUGH DOORS	$ 200.00
02339620018	ABSORB SOUND AT CEILING	$ 416.00

FIGURE 9: SKETCH DETAIL OF DOUBLE GLAZED WINDOWS

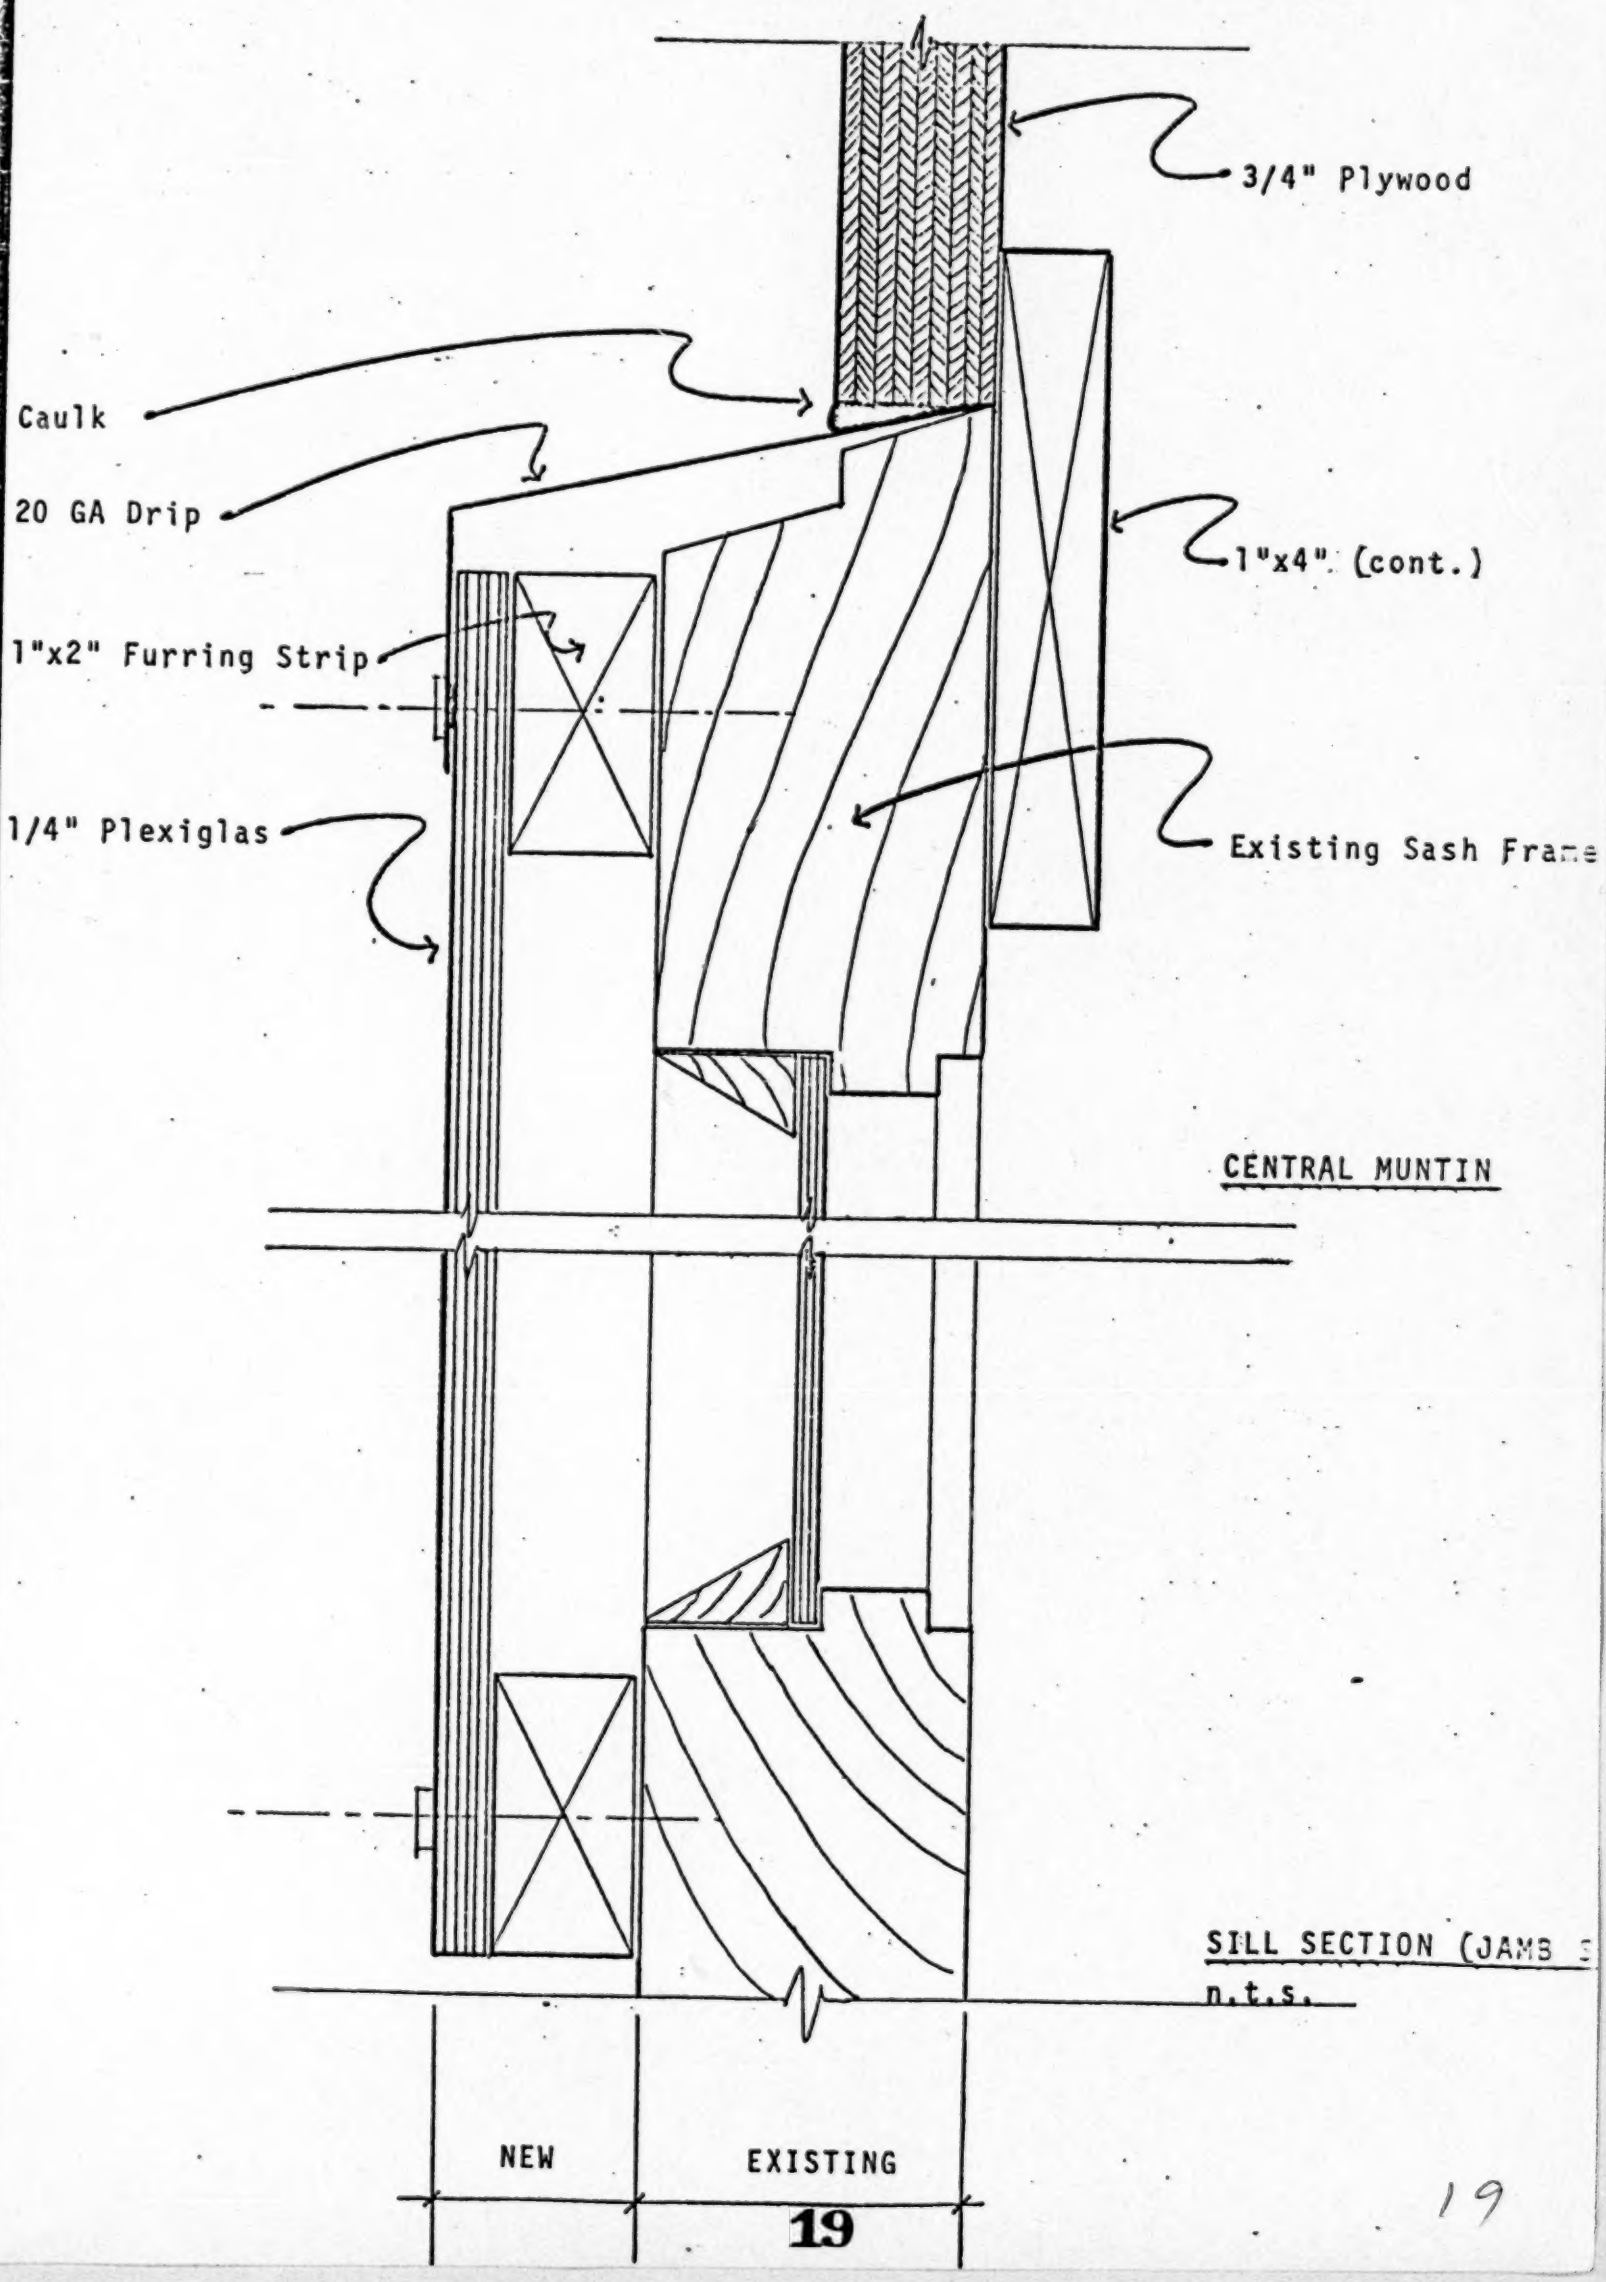

19